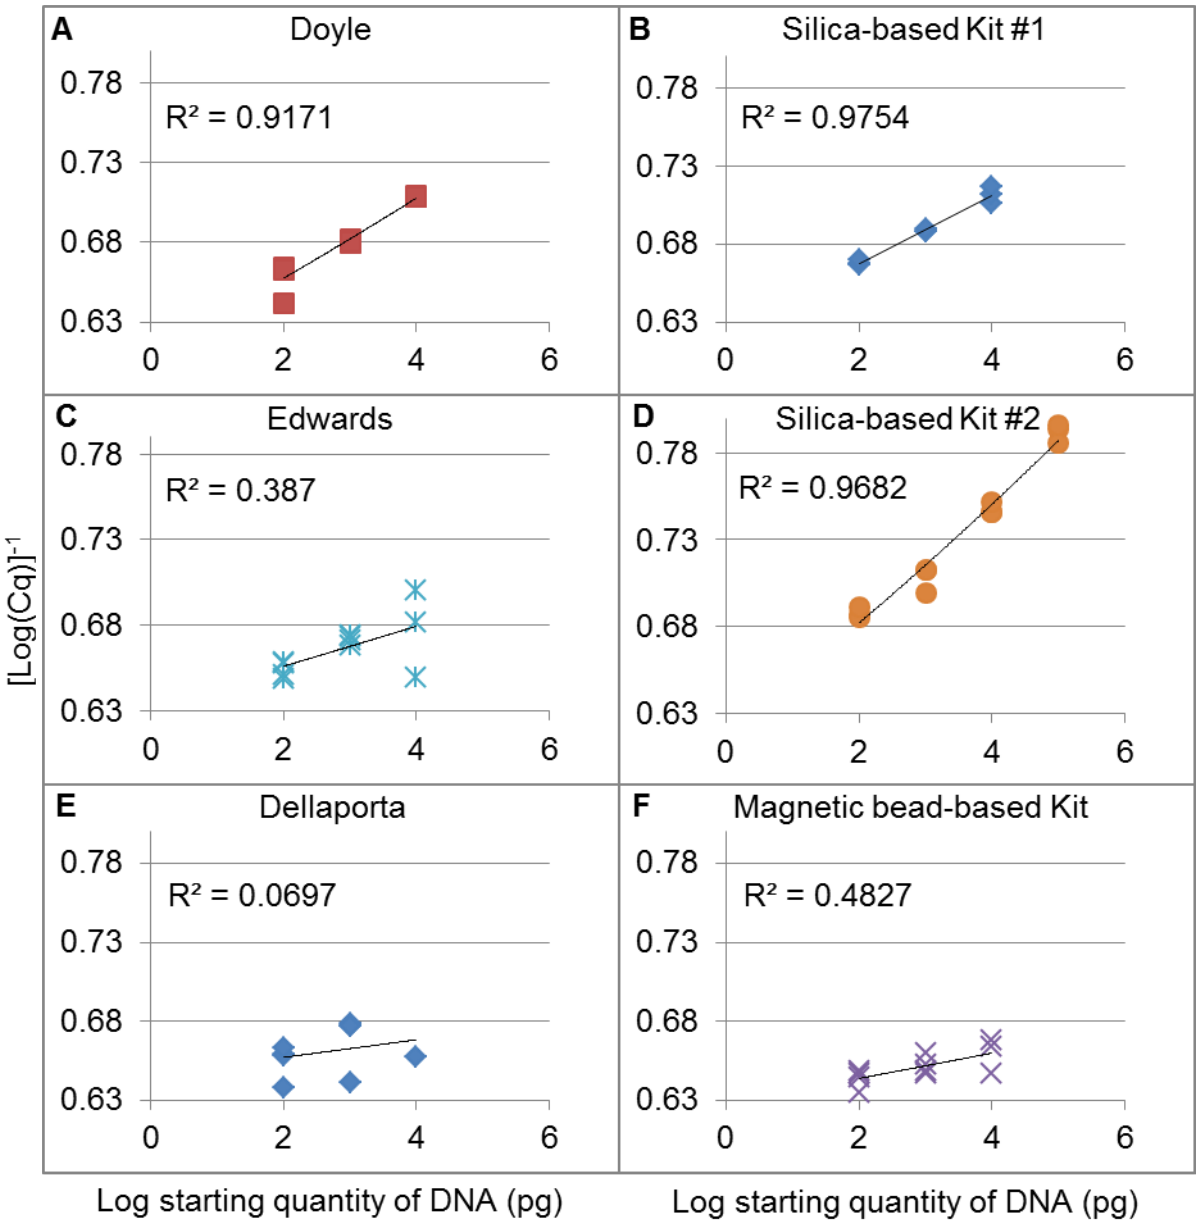
A
Doyle
R² = 0.9171
B
Silica-based Kit #1
R² = 0.9754
C
Edwards
R² = 0.387
D
Silica-based Kit #2
R² = 0.9682
E
Dellaporta
R² = 0.0697
F
Magnetic bead-based Kit
R² = 0.4827
0.78
0.73
0.68
0.63
0
2
4
6
[Log(Cq)]-1
Log starting quantity of DNA (pg)
Log starting quantity of DNA (pg)